



Power Circuit Breakers

Key Lock Mounting
Bracket Kit for
Substructure Cat. No.
TAK1SR01, TAK1SR02,
TAK1SR01F,
TAK1SR02F

CAUTION: To avoid electrical hazard, make sure primary and secondary circuits are not energized while working in the compartment.

KIT CONTENTS (CAT. NO. 343L878G1)

The kit shown in Figure 1 contains the key lock mounting bracket, bracket mounting screws, and #10-32 screws and lockwashers for lock attachment.

INSTRUCTIONS

Attach the mounting bracket to the left racking stud support as shown in Figure 2. Install one mounting screw through the round hole first for accurate positioning.

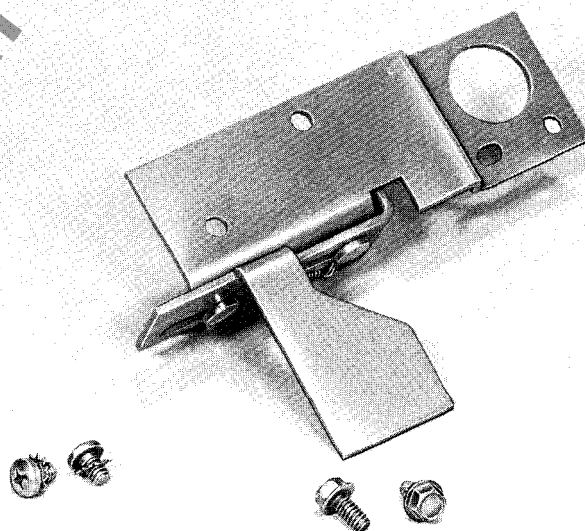


Figure 1.

See back . . .

The lock, ordered separately (see table below), is attached as shown.

With bolt extended, Key:	BBC Key interlock	Superior Key interlock
1 lock Removable	FROE 304448-101	B7003-1-OE-101
2 lock Top removable Bottom retained	M2FROEW 304448-101	B7003-2-OEW-101
2 lock Both removable	M2FROEE 304448-101	B7003-2-OEE-101

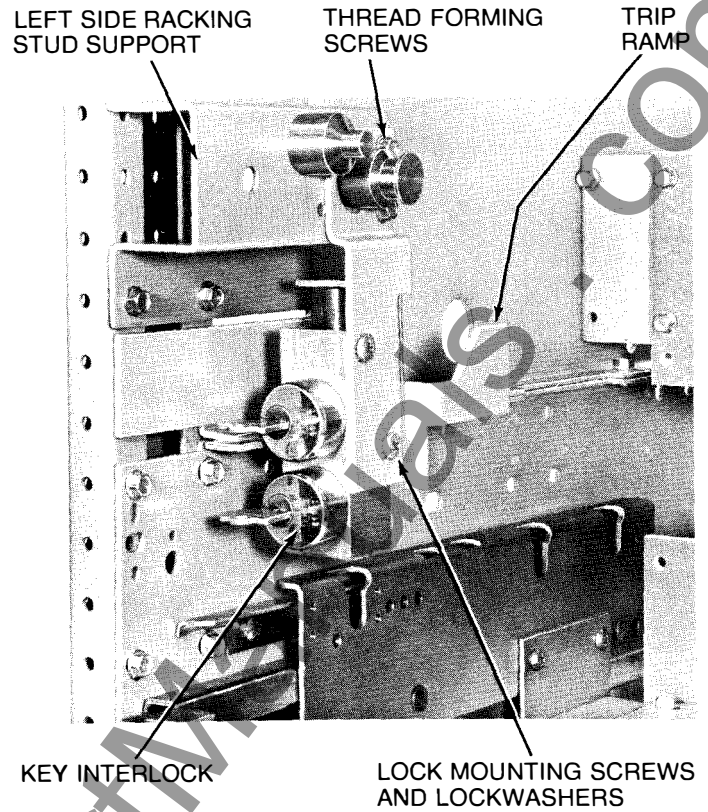


Figure 2.

© 1985 GENERAL ELECTRIC COMPANY

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

For further information
call or write your local
General Electric
Sales Office or . . .

General Electric
Company
41 Woodford Avenue
Plainville, CT 06062 U.S.A.

Outside the U.S. and Canada write International Trading Operations,
570 Lexington Avenue, New York, NY 10022 U.S.A.
GEH-5030 0185 PSA

GENERAL  **ELECTRIC**