




INSTRUCTIONS

GEI-90893A

BREAKMASTER

Stationary Fusible Air Interrupter-Switch Equipment

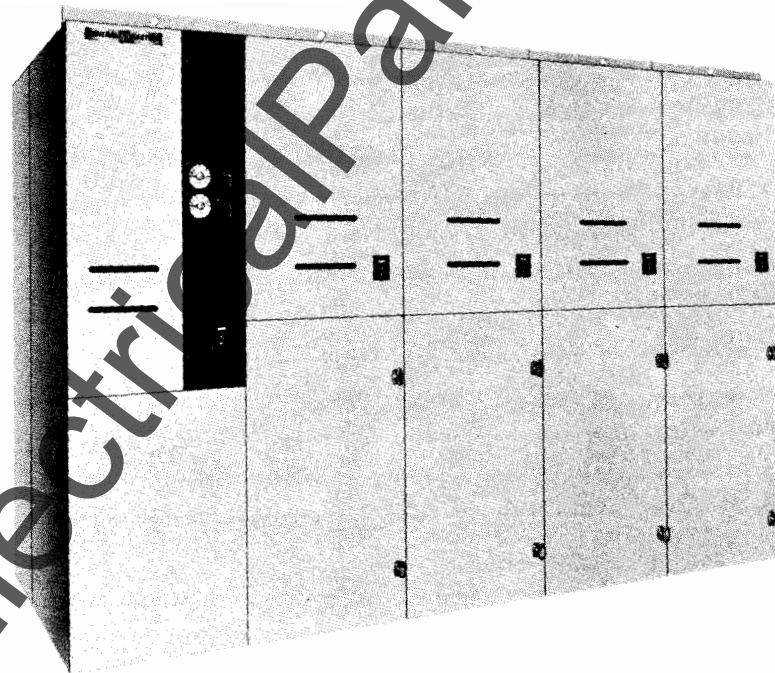

SWITCHGEAR DEPARTMENT

GENERAL  ELECTRIC

PHILADELPHIA, PA.

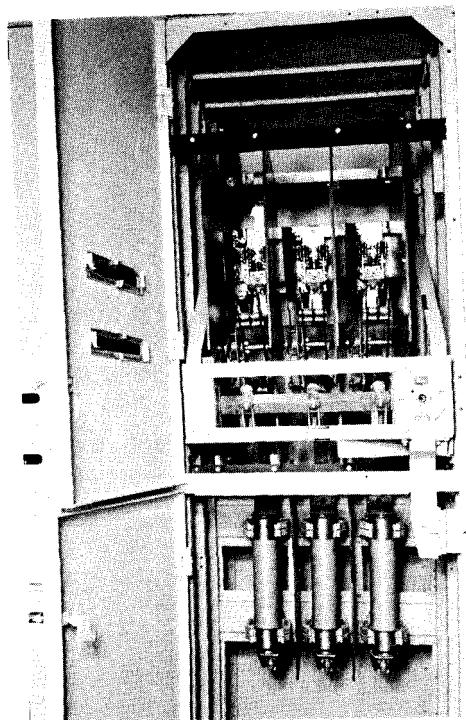


Fig. 8 (8035205)

LVPs air-interrupter selector switch provides maximum service continuity by allowing the operator to switch from one incoming line to the other in case of failure of the primary feed, or to OPEN for planned maintenance.

The switch consists of a two-position (open closed) air-interrupter switch in series with a two-position (Line 1/Line 2) selector switch. The selector switch is a dead-break device mechanically interlocked so it cannot be operated unless the interrupter switch is OPEN.

LVPD Double Break Air-Interrupter Switch - Fig. 5

As an alternate to the LVPs, where there are two separate incoming lines, the three-position (Line 1/ Open/ Line 2) Type LVPD double interrupting switch provides maximum service continuity by allowing the operator to switch from one incoming line to the other in case of failure of a primary feeder, or to OPEN for planned maintenance.

The switch consists of two two-position (open-closed) air-interrupter switches connected in parallel on the load side, key-interlocked so both incoming line switches cannot be closed at the same time. The LVPD double break interrupter switch has the advantage of isolating two lines permitting maintenance of one while the other is energized and reducing the probability of transfer of a fault on one cable to the other.



Fig. 9 (8035207)

RECEIVING, HANDLING AND STORAGE

RECEIVING

Every package leaving the factory is plainly marked with case number, requisition number and customer's order number. If, for any reason, it is necessary to divide the equipment for shipment, the unit numbers of the portion of the equipment enclosed in each shipping package are identified.

Each Breakmaster equipment leaving the factory is carefully inspected and packed by personnel experienced in the proper handling and packing of electrical equipment. Upon receipt of any apparatus, make an inspection immediately for damage sustained while enroute. If injury is evident, or indication of rough handling is visible, file a claim for damage at once with the transportation company. Notify the General Electric Co. Apparatus Sales Office promptly. Information on damaged parts, part number, case number, requisition number, etc., should accompany the claim.

The package containing miscellaneous parts is normally located within the equipment for shipment. The envelope containing instruction books and drawings is taped to the inside of the equipment door.

To avoid the loss of small parts, the contents of each case should be carefully checked before discarding the packing material.

Some of the miscellaneous parts that are furnished when required are listed below.

For Breakmaster lineups:

Power Fuses	
Tube of Contact Lubricant D50H47	
Can of Sand Gray Paint	
Can of Blue Paint	
Hardware for Shipping Splits	
Pothead Compound	
Can of Thinner	
Rubber Seal	} Outdoor Only
Cement	
Floor Clamps	
Switch Operating Handle	
Switch Maintenance Handle	
Insulating material consisting of sufficient quantities of	
I-202 Tape	
Varnish A50H77	
Glass Tape A2L12B	
Filler A50H 119	

is furnished for insulating the connection bars to potheads. Since these bars cannot be insulated until purchaser's cables are installed they must be insulated in the field.

For LVP Switch Units:

The same as above plus sufficient quantities of insulating materials same as listed above for insulating the primary bushings of the transformer.

Insulating material is never furnished for purchaser's connections to incoming or outgoing leads unless specifically ordered.

HANDLING

Refer to Installation Drawings 931D100 Sh. 2 for line-up equipments, Sh. 3 for in and out units and Sh. 4 for LVP units.

The equipment may be most conveniently handled by a crane. Removable lifting angles are provided on top of the equipment. If the installer uses a crane for lifting, a cable spreader must be used to obtain a vertical pull on the lifting angles.

If crane facilities are not available, the equipment may be moved into position by means of construction rollers placed under the shipping skid. Where overhead is too low, the shipping skid may be removed and the equipment moved by rollers placed under the three channels under the equipment.

CAUTION: Be sure the rollers used are spaced such that the three channels rest on top of the rollers, as a direct application of the rollers between the channels may tear or distort the equipment. Jacks may also be applied to handle the equipment when a crane is not available. Fork lift trucks must never be used to handle equipment.

Remove all outer crating after the equipment has been moved to the desired location.

Methods of handling outdoor equipment are much the same as for indoor equipments except that lifting plates are provided at the base of the structure. The lifting plates should be removed after the equipment is permanently anchored, so that passageway at the ends of the equipment will not be obstructed.

STORAGE

If it is necessary to store the equipment for any length of time, the following precautions should be taken to prevent breakage, corrosion, damage or deterioration:

1. Uncrate the equipment. Check thoroughly for damage.
2. Store in a clean, dry, rodent free location with moderate temperature and cover with a suitable canvas to prevent dust, dirt, water, or other foreign substances from entering the switchgear.
3. If dampness or condensation is encountered in the storage location, heaters must be placed inside the units to prevent moisture damage. Approximately 250 watts of heaters per unit are required. On outdoor switchgear this may readily be accomplished in making a temporary power supply connection to the heaters already installed in the equipment.

CAUTION: Remove all cartons and other miscellaneous packing material from inside the units before energizing any heaters.

EQUIPMENT INSTALLATION

PRIOR TO INSTALLATION

Before any installation work is performed, study all drawings furnished by the General Electric Company for the particular installation. These include arrangement drawings, installation drawings, and when required, connection diagrams, elementary and summary. When requesting information from the factory on any specific item furnished with the equipment, refer to the requisition and summary number. Any material external to the equipment which may be required to meet any local codes, such as mats, screens, railings, warning signs, etc., are not furnished.

LOCATION

In locating the Breakmaster Equipment, consideration should be given to the aisle space required at the front and, when required, rear of the equipment. The recommended aisle space is shown on the floor plan drawing furnished for the particular installation. The space at the front must be sufficient to permit the opening of doors. The space at the rear must be sufficient for opening of doors, removing covers, installation of cables, inspection, and maintenance. Check local codes for special aisle space requirements.

FOUNDATION REQUIREMENTS

Indoor Equipment

The station floor or foundation must be strong enough to prevent sagging by the weight of the switchgear structure. If the foundation is subject to vibrations, special mounting must be provided to prevent the transmittal of vibrations to the equipment.

Suitable means must be provided by the purchaser for mounting and anchoring the switchgear to the floor. The equipment is furnished with built in channels, eliminating the need for floor steel when mounting on a smooth level floor. When embedded channels are desired, they should be in a level concrete slab with the top surface of the channels extending above the concrete sub floor (about 3/4 inch). It is imperative that floor steel be even with finished floor and that both be level prior to the final anchoring to avoid distortion of the switchgear structure. The recommended foundation construction and method of mounting the switchgear to the foundation is shown on installation drawings. At the time the foundation channels are being installed, any conduits or sleeves required for power and control cables that are to enter the equipment from underneath should be located and installed within the available space shown on the floor plan drawings. Consideration should be given to installing conduits or sleeves which might be required for future connections. The conduits should terminate at the switchgear with the appropriate conduit connectors.

Outdoor Equipment

Foundation recommendations for outdoor equipment also are given in installation drawings.

REMOVING SHIPPING SKID - Indoor Equipment Only

If practical, the shipping skid should be left on the equipment until it is at or near its final location.

The skid is bolted to the equipment through the anchor bolt holes used for final installation. The bolts in the equipment may be removed by opening the front doors.

ANCHORING

The equipment should be mounted on top of the steel channels in a position as shown on installation drawings and securely anchored to the channels. As the units are mounted onto the foundation channels, they should be bolted together as described under assembly.

There are several good methods of anchoring the equipment to the foundation channels. One of the methods for anchoring indoor equipment only is to use 1/2 inch anchor bolts through the holes provided in the bottom of the switchgear equipment as shown in the floor plan view drawing furnished with the equipment. Another method is to tack weld the bottom channel of the equipment to the foundation channel at the anchor bolt holes.

Suggested methods for anchoring outdoor equipment are also illustrated in installation drawings. All of these methods use an anchor bolt and floor clamp to secure the supporting channel to the foundation.

ASSEMBLY OF EQUIPMENT

Indoor Equipment

Before assembly of the equipment is begun, all components should be on hand so that work may proceed without delay. The individual shipping packages must be connected together in position on the foundation. When assembling individual shipping packages, start with the middle section to insure minimum deviation from the overall length dimension. Assemble as follows:

1. If the Breakmaster equipment is part of a load-center unit substation, the transformer section should be set on its pad in accordance with the proper instructions furnished with the transformer.
2. The switchgear and Breakmaster packages should then be placed on their foundations with the aid of crane or jacks as previously described.
3. These packages should be connected and bolted together in the following manner:
 - a. Bolt the packages together using 3/8-1 bolts, lockwashers and nuts at the points shown on the installation drawings.
 - b. Connect together the main buses and ground buses, of adjacent shipping packages using the splice bars furnished with the equipment (See Table A required torque values for various size bolts).

TABLE A

TORQUE VALUES FOR BREAKMASTER EQUIPMENT HARDWARE

Insulation-Copper-Steel

BOLT SIZE	FOOT-POUNDS
1/4 - 20	5 - 8
3/8 - 16	15 - 20
1/2 - 13	30 - 40
5/8 - 11	35 - 45

- c. Route and connect control cables between units at the shipping splits. Make the necessary connections by referring to the connection diagram to determine what leads and how many are to be connected.
4. The equipment should be anchored to the foundation by anchor bolts, or tack welds as specified under the paragraph headed "Anchoring".

5. All shipping supports must be removed from the switchgear.
6. Make a final inspection to see that there are no tools, construction materials, or other foreign matter left in the switchgear.

INTERLOCKS

(a) After initial installation of the switchgear equipment, all necessary interlock keys should be inserted into the appropriate locks and all spare keys should be placed in the hands of a responsible person. This precaution is necessary since improper use of spare keys will defeat the interlocking scheme.

(b) All fused switches are equipped with a mechanical interlock that prevents opening the fuse door until the switch is first opened. The switch cannot be reclosed as long as the fuse door is open. This interlock must be examined before energization of the equipment to insure that it did not get out of adjustment during shipment.

(c) In those instances where control power is furnished with the equipment, a key interlock with auxiliary switch is furnished on the access door to the primary fuses of the control power transformer. The auxiliary switch contacts are wired in series with the secondary of the control power transformer and disconnect the load automatically when the access door is opened. This prevents inadvertent pulling of primary fuses with a secondary load.

Operation Test-Load Break Switch

Refer to GEI-88767 instruction manual for preoperational checks on the load break switch.

BUS BARS

When making bolted bus bar connections to adjoining equipment, proceed as follows:

(a) Clean the silver plated contacting surfaces with a clean cloth or solvent, if required. Sandpaper or other abrasives must not be used. Apply lubricant, D50H47, furnished with each equipment to the contact surface.

(b) Bolt the splice bar to the bus using a bolt, washer, and lockwasher for each bus connection. Refer to Table A for the proper torque values.

Outdoor Equipment - Assembly of outdoor equipment is the same as for the indoor equipment with the following exceptions:

(a) Check alignment of doors on outdoor equipment to insure that the weatherproof seal has not been disturbed.

(b) When joining shipping packages, special procedures for weatherproofing must be followed as indicated in installation drawings. The joint in

the roof between units and shipping splits must be weatherproofed. This is done by placing a rubber seal between roof flanges. Bolt this joint together, using 3/8-16 hex head bolts, lockwashers and hex nuts. A roof cap is placed over this seam and held in place by the roof trim. Joints between transformer throat and switchgear, and between shipping splits, must also be weatherproofed. Install a front and rear rubber seal at the shipping split joints.

Remove the lifting plates from front and rear of the switchgear base at both ends of the shipping split joint.

The gasket for outdoor transformers are furnished with the transformer, the hardware for connecting transformer flange to the switchgear is supplied with the switchgear.

PRIMARY CABLE

Before primary cable connections are made, the cables should be identified to indicate their phase relationship with the switchgear connections. This is necessary to insure that the connections are made so that motors will rotate in the proper direction and the phase rotation is the same when tying two different sources of power together.

There are two common methods of making primary cable connections:

(a) Potheads are used when it is desired to hermetically seal the end of the cable to make a moisture proof connection between the cable and the switchgear bus. A pothead also prevents seeping of oil from the end of oil impregnated varnished cambric or paper insulated cable.

(b) Clamp type terminals with mechanical entrance device.

In all cases carefully follow the cable manufacturer's recommendations for installation of the type of cable being used, as well as the instructions contained in GEI-28838.

For system voltage above 7500 volts it is recommended that stress relief cones be built up when single-conductor or three-conductor shielded cable is used. Construct stress relief cones in accordance with the recommendations of the cable manufacturer. See GEI-28838 for one recommended method. On lower voltage cables, belling out the end of the lead sheath ordinarily provides sufficient stress relief. (Stress cone material will not be furnished with pothead).

TESTING AND INSPECTION

After the equipment has been installed and all connections made, it must be tested and inspected before putting it in service. Although the equipment and devices have been tested at the factory, a final field test must be made to be sure that the equipment has been properly installed and that all connections are correct. The primary equipment must be completely de-energized while the tests are in progress.

Directions for testing instruments and meters are given in the instruction book furnished for each device.

The General Electric Company will not be responsible for defects in devices not manufactured by the Company when such devices are specified by the purchaser. All questions relative to such devices should be referred to the manufacturer.

The extent of the tests on the equipment as a whole will depend on the type and function of the equipment. Tests which should be performed, however, include air-interrupter switch operation, phasing, and grounding checks.

High potential tests to check the integrity of the insulation are not necessary if the installation instructions in this book are carefully followed. If the purchaser wishes to make high potential tests the voltage should not exceed 75% of the factory test voltages.

Potential transformers must be disconnected during high voltage testing.

MAINTENANCE

A periodic maintenance schedule must be established to obtain the best service from the switchgear. An annual check and overall maintenance procedure for the switchgear devices and all connections, must be followed as a minimum requirement. Equipment subject to highly repetitive operation may require more frequent maintenance.

A permanent record of all maintenance work must be kept. The record should include a list of periodic checks and tests made, the date they were made, the condition of the equipment, and any repairs or adjustments that were performed. Maintenance employees must follow all recognized safety practices, such as those contained in the National Electrical Safety Code and in company or other safety regulations during maintenance.

WARNING: Solid insulation surrounding an energized conductor and power apparatus must never be relied upon to provide protection to personnel.

For specific information regarding the maintenance of devices, such as load break switch, lightning arresters, meters, etc., refer to the separate instruction book furnished for each device.

DEVICES & COMPARTMENTS

Switches-Test and inspect all switches for proper operation as described in GEI-88767 "Load Break Switch".

Check and inspect all devices to see that they are functioning properly. Check that all electrical connections are tight. Check mounting of the devices.

Compartment Interiors

(a) Thoroughly clean interior of compartments. Use a vacuum cleaner and clean rags only. Do not use steel wool, or oxide papers. Blowing with compressed air is not recommended.

(b) Check indicating devices, mechanical and key interlocks.

BUS COMPARTMENT

To perform the following remove the steel top, rear and end sheets.

(a) Before any covers are removed or any doors opened which permit access to the primary circuits, it is essential that the circuits be de-energized.

(b) Check that all bus mounting bolts and splice connection bolts are tight.

(c) Wipe and vacuum clean the busses and supports.

Feeder Cable & Primary Cable Terminations

(a) Inspect all main cable connections for signs of overheating, and tighten all connections.

(b) Check that all secondary control wiring connections are tight and all control cabling is intact.

(c) Check all bolts that secure the terminals for tightness.

(d) Check the ground bus connection and mounting bolts for tightness, and clean the ground bus.

Overall Switchgear

(a) Clean and inspect all painted surfaces and retouch where necessary.

(b) Check to see that all anchor bolts and other structural bolts are tight.

(c) Check that all door latches operate properly.

PAINT REFINISHING

Indoor and Outdoor Primer

1. Remove all loose paint, rust, scale, oil or grease. Sand scratches smooth before priming.

2. Materials

a. Synthetic phenolic, alkyd paint 214-488 Sand Gray as made by Arco Co.

b. Thinner Xylol made by Standard Oil Co.

c. Viscosity 30 seconds Zahn #2 cup.

3. Application

- a. Primer is preheated to 185°F and sprayed with DeVilbiss type hot spray unit.
- b. Air dry 30 minutes.
- c. Thickness of paint coating 0.45 to 0.65 mils.

Indoor Finish Coat

1. Materials

- a. Sand Gray lacquer 246-84296 as made by DuPont Co.
- b. Blue lacquer 254-84299 as made by DuPont Co.
- c. Lacquer thinner.
- d. Viscosity Sand Gray 25 seconds Zahn #2 cup. Blue 27 seconds Zahn #2 cup.

2. Application

- a. Spray one wet coat.
- b. Air dry 30 minutes.
- c. Thickness 1.00 mil.

Outdoor Finish

1. This finish is applied to surfaces previously cleaned and primed.

2. Materials

- a. Acrylic Sealer 881-007 as made by DuPont Co.
- b. Acrylic Lacquer ASA-24 as made by G.E. Co. #200.

- c. Acrylic thinner E-615 as made by Geo. Senn Co.

3. Application - Sealer Coat

- a. Reduce sealer to spraying viscosity using 5 parts 881-007 to 6 parts E-615.
- b. Spray one coat of sealer.
- c. Air dry one hour.

4. Application - Finish Coat

- a. Reduce G.E. 200 with E-615 to spraying viscosity of 17 seconds Zahn #2 cup.
- b. Apply one coat of finish.
- c. Air dry 30 minutes.
- d. Thickness of finish coat 1.00 mil.

RENEWAL PARTS

Ordering Instructions

1. Renewal parts should be ordered from the nearest Sales Office of the General Electric Co.
2. Always specify the requisition number on which the equipment was originally furnished.
3. Specify the quantity, reference number, description and this Bulletin number.
4. Standard hardware, such as screws, bolts, nuts, washers, etc., is not listed. Such items should be purchased locally.
5. For prices, refer to the nearest office of the General Electric Company.
6. If insulating material, such as tape, varnish, compound, etc., is required, it must be specified separately.

GENERAL ELECTRIC INSTALLATION AND SERVICE ENGINEERING OFFICES

FIELD SERVICE OFFICE CODE KEY
 * Mechanical & Nuclear Service
 † Electrical & Electronic Service
 ‡ Marine Service
 † Transportation

FOR YOUR LASTING SATISFACTION . . . with the performance and availability of your General Electric equipment, GE provides this nationwide network of field service offices, serving utility, industrial, transportation and marine users. Qualified field engineers provide installation, start-up, employee training, engineering maintenance and other services, throughout the productive life of the equipment. For full information, call your nearest Installation & Service Engineering office.

- ALABAMA**
 * † Birmingham 35205 2151 Highland Ave.
 * † Mobile 36609 1111 S. Beltline Highway
- ALASKA**
 † Anchorage 99501 115 Whitney Rd.
- ARIZONA**
 * † Phoenix 85012 3550 N. Central Ave.
 † Tucson 85716 151 S. Tucson Blvd.
- ARKANSAS**
 † North Little Rock 72119 120 Main St.
- CALIFORNIA**
 * † † Los Angeles 90054 212 N. Vignes St.
 † Palo Alto 94303 960 San Antonio Rd.
 † Sacramento 95808 2407 J St.
 † San Diego 92103 2560 First Ave.
 * † San Francisco 94119 55 Hawthorne St.
 * † Vernon 90058 3035 E. 46th St.
- COLORADO**
 * † Denver 80206 201 University Blvd.
- CONNECTICUT**
 † Meriden 06450 1 Prestige Dr.
- FLORIDA**
 † † Jacksonville 32203 4040 Woodcock Dr.
 † Miami 33134 4100 W. Flagler St.
 * † Tampa 33609 2106 S. Lois Ave.
- GEORGIA**
 * † † Atlanta 30309 1660 Peachtree Rd., NW
 † Savannah 31405 5002 Paulsen St.
- HAWAII**
 * † † Honolulu 96813 440 Coral St.
- ILLINOIS**
 * † † † Chicago 60680 840 S. Canal St.
- INDIANA**
 † Evansville 47705 2709 Washington Ave.
 † Fort Wayne 46807 3606 S. Calhoun St.
 * † Indianapolis 46207 3750 N. Meridian St.
- IOWA**
 † Davenport 52805 P.O. Box 630, 1039 State St., Bettendorf
- KENTUCKY**
 † Louisville 40218 2300 Meadow Dr.

- LOUISIANA**
 † † Baton Rouge 70806 8312 Florida Blvd.
 * † † New Orleans 70125 4747 Earhart Blvd.
 † † Shreveport 71104 2620 Centenary Blvd.
 † † Monroe 71201 1028 North 6th St.
- MARYLAND**
 * † † Baltimore 21201 1 N. Charles St.
- MASSACHUSETTS**
 † † Wellesley 02181 1 Washington St.
- MICHIGAN**
 * † † Detroit 48202 700 Antoinette St.
 † † Jackson 49201 210 W. Franklin St.
 † † Saginaw 48607 1008 Second National Bank Bldg.
- MINNESOTA**
 * † † Duluth 55802 300 W. Superior St.
 * † † Minneapolis 55416 1500 Lilac Drive So.
- MISSOURI**
 * † † Kansas City 64199 911 Main St.
 † † St. Louis 63101 1015 Locust St.
- MONTANA**
 † Butte 59701 103 N. Wyoming St.
- NEBRASKA**
 * † Omaha 68102 409 S. 17th St.
- NEW JERSEY**
 * † Millburn 07041 25 E. Willow St.
- NEW YORK**
 † † Albany 12205 15 Computer Drive, West
 † † Buffalo 14205 525 Delaware Ave.
 * † † New York 10022 641 Lexington Ave.
 † † Rochester 14604 89 East Ave.
 † † Syracuse 13206 3532 James St.
- NORTH CAROLINA**
 * † † Charlotte 28207 141 Providence Rd.
 † † Wilmington P.O. Box 186
 † † Reigelwood 28456 P.O. Box 186
- OHIO**
 * † † Cincinnati 45206 2621 Victory Pkwy.
 * † † Cleveland 44104 1000 Lakeside Ave.
 † † Columbus 43229 1110 Morse Rd.
 † † Toledo 43606 3125 Douglas Rd.
 † † Youngstown 44507 272 Indianola Ave.

- OKLAHOMA**
 * † Oklahoma City 73106 2000 Classen Blvd.
 † † Tulsa 74105 P.O. Box 7646, Southside Sta.
- OREGON**
 † Eugene 97401 1170 Pearl St.
 * † † Portland 97210 2929 NW 29th Ave.
- PENNSYLVANIA**
 † Allentown 18102 1444 Hamilton St.
 * † † Philadelphia 19102 3 Penn Center Plaza
 † † Pittsburgh 15222 300 6th Avenue Bldg.
- SOUTH CAROLINA**
 † † Columbia 29204 2700 Middleburg Dr.
 † † Greenville 29607 41 No. Pleasantburg Dr.
- TENNESSEE**
 * † Chattanooga 37411 5800 Bldg, Eastgate Center
 † † Memphis 38130 3385 Airways Blvd.
- TEXAS**
 * † † Amarillo 79101 303 Polk St.
 * † † Beaumont 77704 1385 Calder Ave.
 † † Corpus Christi 78401 205 N. Chaparral St.
 † † Dallas 75227 8101 Stemmons Freeway
 † † El Paso 79945 215 N. Stanton
 † † Fort Worth 76102 408 W. Severth St.
 † † Houston 77027 4219 Richmond Ave.
 † † San Antonio 78204 434 S. Main St.
- UTAH**
 † Salt Lake City 84111 431 S. Third East St.
- VIRGINIA**
 * † † Newport News 23601 311 Main St.
 † † Richmond 23230 1508 Willow Lawn Dr.
 † † Roanoke 24015 2018 Colonial Ave.
- WASHINGTON**
 * † † Seattle 98188 112 Andover Park East, Tukwila
 † † Spokane 99202 E. 1805 Trent Ave.
- WEST VIRGINIA**
 * † Charleston 25328 306 MacCorkle Ave., SE
- WISCONSIN**
 † Appleton 54911 3003 West College Dr.
 † † Milwaukee 53202 615 E. Michigan St.

GENERAL ELECTRIC SERVICE SHOPS

WHEN YOU NEED SERVICE . . . These GE Service Shops will repair, recondition, and rebuild your electric apparatus. The facilities are available day and night, seven days a week, for work in the shops or on your premises. Latest factory methods and genuine GE renewal parts are used to maintain performance of your equipment. For full information about these services, contact your nearest service shop or sales office.

- ALABAMA**
 • Birmingham 35211 1500 Mims Ave., S.W.
 • Mobile 36609 721 Lakeside Dr.
- ARIZONA**
 • (Phoenix) Glendale 85019 4911 W. Colter St.
 • Phoenix 85019 3840 W. Clarendon St.
 • Tucson 85713 2942 So. Palo Verde Ave.
- CALIFORNIA**
 • Los Angeles 90301 6900 Stanford Ave.
 • (Los Angeles) Anaheim 92805
 • 3601 E. LaPalms Ave.
 • (Los Angeles) Inglewood 90301
 • 228 W. Florence Ave.
 • Sacramento 95814 99 North 14th St.
 • (San Francisco) Oakland 94606
 • 1650 34th St.
- COLORADO**
 • Denver 80205 3353 Larimer St.
- CONNECTICUT**
 • (Southington) Plantville 06479
 • 370 Atwater St.
- FLORIDA**
 • Jacksonville 32203 2020 W. Beaver St.
 • (Miami) Hialeah 33010 1082 East 28th St.
 • Tampa 33601 19th & Grant Sts.
- GEORGIA**
 • (Atlanta) Chamblee 30341
 • 5035 Peachtree Industrial Blvd.
 • Atlanta 2379 John Glenn Dr.
- ILLINOIS**
 • Chicago 60638 6045 S. Nottingham Ave.
- INDIANA**
 • Evansville 47711 401 N. Congress Ave.
 • Ft. Wayne 46803 1731 Edsall Ave.
 • Hammond 46320 1138 184th Place
 • Indianapolis 46222 1740 W. Vermont St.
- IOWA**
 • (Davenport) Bettendorf 52722 1025 State St.
- KENTUCKY**
 • Louisville 40209 3900 Crittenden Drive

- LOUISIANA**
 • Baton Rouge 70814 10955 North Dual St.
 • New Orleans 70114 1115 DeArmas St.
- MARYLAND**
 • Baltimore 21230 920 E. Fort Ave.
- MASSACHUSETTS**
 • • (Boston) Medford 02155
 • 3960 Mystic Valley Pkwy.
- MICHIGAN**
 • • (Detroit) Riverview 18075 Krause Ave.
 • Flint 48505 1506 E. Carpenter Rd.
- MINNESOTA**
 • Duluth 55807 50th Ave. W & St. Louis Bay
 • Minneapolis 55430 2025 49th Ave., N.
- MISSOURI**
 • Kansas City 64120 3525 Gardner Ave.
 • St. Louis 63110 1115 East Rd.
- NEW JERSEY**
 • New Brunswick 08902 3 Lawrence St.
- NEW MEXICO**
 • Albuquerque 87109 4420 McLeod Rd. NE
- NEW YORK**
 • Albany 12205 1097 Central Ave.
 • (Buffalo) Tonawanda 14150 175 Milens Rd.
 • (Long Island) Old Bethpage 11804
 • 163 Jethpage-Sweet Hollow Rd.
 • (New York City) North Bergen, N. J. 07012
 • (New York City) Clifton, N. J. 07012
 • 9 Brighton Rd.
 • Schenectady 12305 1 River Rd.
 • Syracuse 13208 1015 E. Hiawatha Blvd.
- NORTH CAROLINA**
 • Charlotte 28208 2328 Thrift Rd.
- OHIO**
 • Akron (Canton) 44720
 • 7900 Whipple Ave. N. W.
 • Cincinnati 45202 444 West 3rd St.
 • Cleveland 44125 4477 East 49th St.
 • Columbus 43229 6660 Huntley Rd.
 • Toledo 43605 405 Dearborn Ave.
 • Youngstown 44507 272 E. Indianola Ave.

- OKLAHOMA**
 • Tulsa 74145 5220 S. 100th East Ave.
- OREGON**
 • Eugene 97402 570 Wilson St.
 • Portland 97210 2727 NW 29th Ave.
- PENNSYLVANIA**
 • Allentown 18103 668 E. Highland St.
 • (Delaware Valley) Cherry Hill, N. J. 08034
 • 1790 E. Marlon Pike
 • Johnstown 15802 841 Oak St.
 • Philadelphia 19124 1040 East Erie Ave.
 • (Pittsburgh) West Mifflin 15122
 • 4930 Buttermilk Hollow Rd.
 • York 17403 54 N. Harrison St.
- SOUTH CAROLINA**
 • (Charleston) No. Charleston 29401
 • 2490 Debonair St.
- TENNESSEE**
 • Knoxville 37914
 • 2621 Governor John Sevier Hwy.
 • Memphis 38107 708 North Main St.
- TEXAS**
 • Beaumont 77705 1490 W. Cardinal Dr.
 • Corpus Christi 78401 115 Waco St.
 • Dallas 75235 3202 Manor Way
 • Houston 77036 5534 Harvey Wilson Dr.
 • Houston 77036 6916 Harwin Dr.
 • Midland 79701 704 S. Johnston St.
- UTAH**
 • Salt Lake City 84110 301 S. 7th West St.
- VIRGINIA**
 • Richmond 23224 1403 Ingram Ave.
 • Roanoke 24013 1004 River Ave., SE
- WASHINGTON**
 • Seattle 98134 3422 First Ave., South
 • Spokane 99211 E. 4323 Mission St.
- WEST VIRGINIA**
 • Charleston 25328 306 MacCorkle Ave., SE
- WISCONSIN**
 • Appleton Menasha 54910 1725 Racine St.
 • Milwaukee 53207 235 W. Oklahoma Ave.

• Electrical/Mechanical Service Shop • Instrumentation Shop Δ Special Manufacturing Shop